



1 DETAIL
 E2.14 SCALE: NONE




2 DETAIL
 E2.14 SCALE: NONE

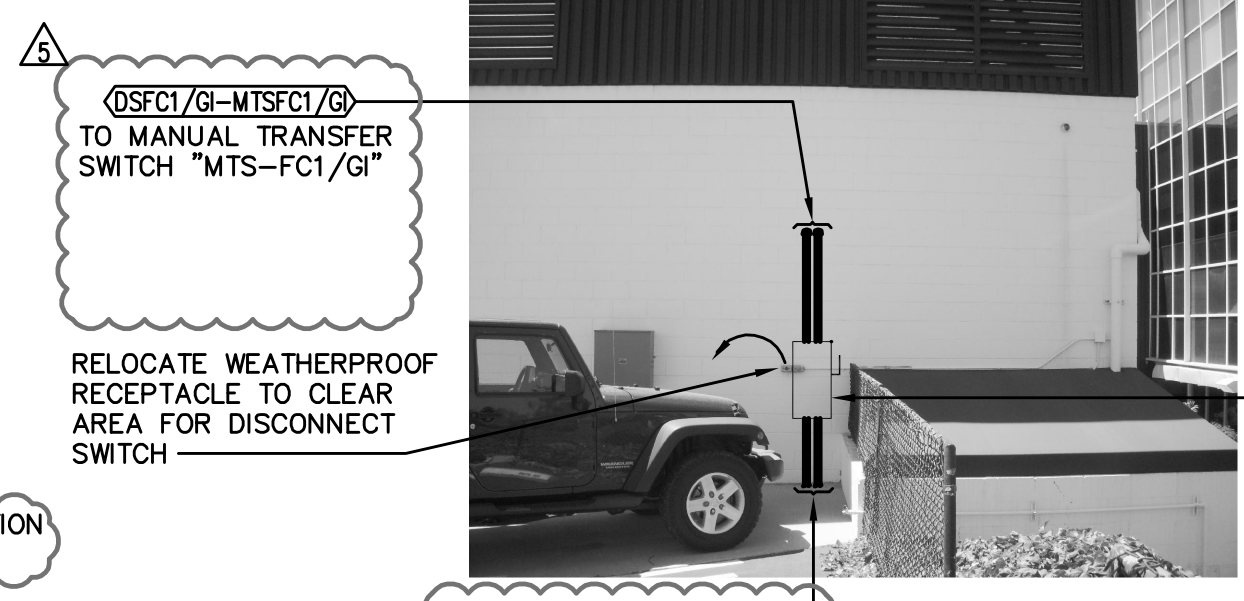

3 DETAIL
 E2.14 SCALE: NONE

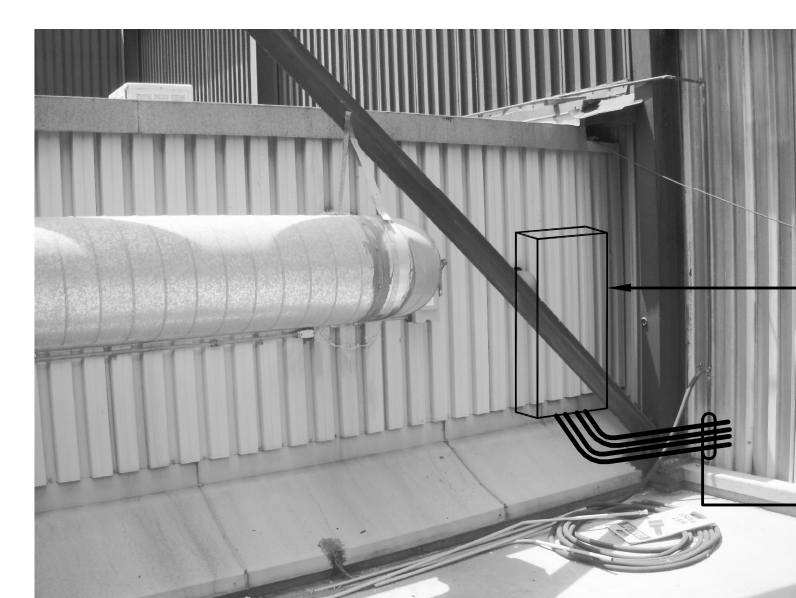

4 DETAIL
 E2.14 SCALE: NONE

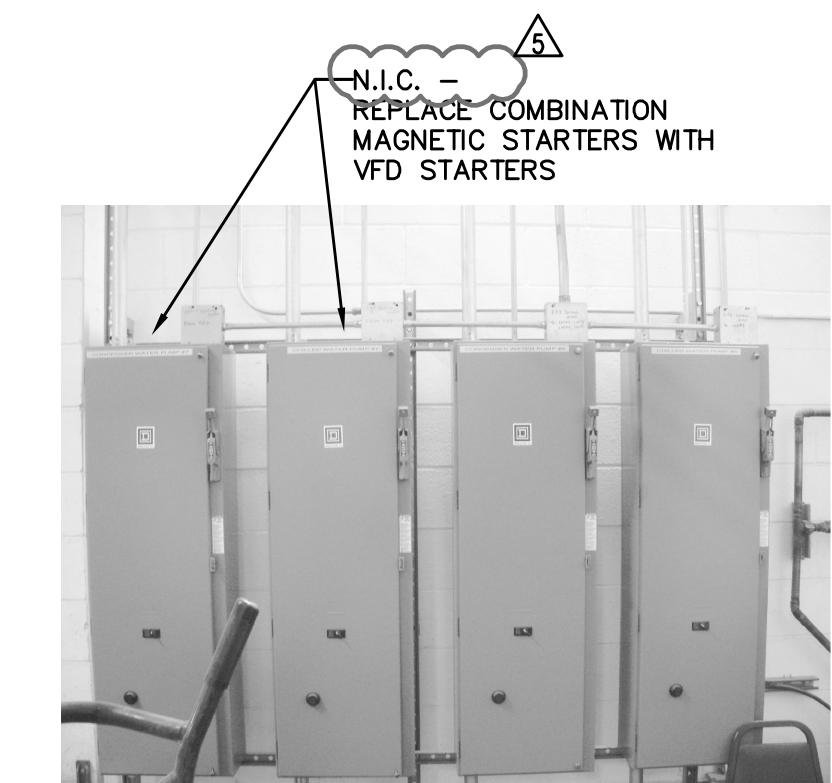


5 PHOTO RECORD - EXISTING ENCLOSED MOTOR CONTROLLERS (IN CHILLER BUILDING)
 E2.14 SCALE: NONE



6 PHOTO RECORD - EXISTING EMS CONTROL PANEL
 E2.14 SCALE: NONE



7 DETAIL
 E2.14 SCALE: NONE

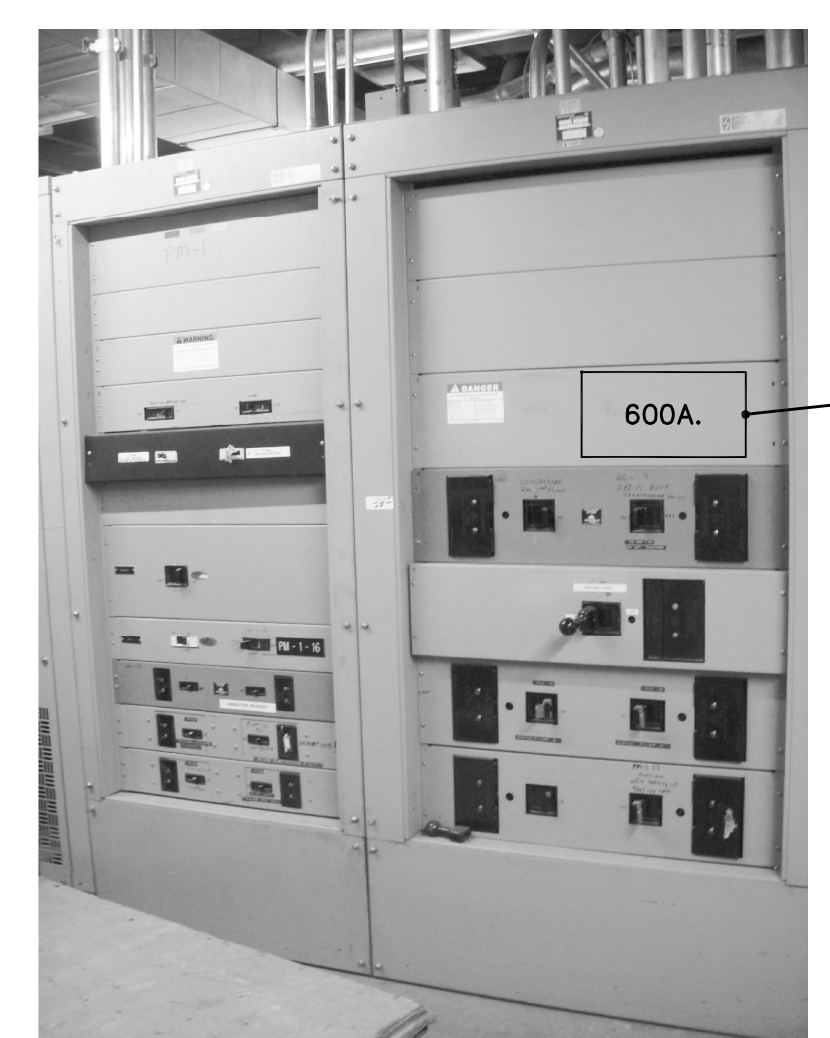

8 DETAIL [DISTRIBUTION BOARD "PM"]
 E2.14 SCALE: NONE




9 PHOTO RECORD - EXISTING "THE BIG RED" STANDBY GENSET
 E2.14 SCALE: NONE

ELECTRICAL DETAILS - MISCELLANEOUS

ID	DATE	REMARKS
1	17/02/12	PRELIMINARY DESIGN REVIEW
2	20/02/12	PLAN CHECK
3	19/04/12	BID CLARIFICATIONS
4	19/07/12	UTC RECOMMENDED CORRECTIONS
5	10/08/12	UTC - REV. PLAN CHECK CORRECTIONS

ENGR:	TEAM 1
CHK'D BY:	RL
DATE:	9/19/12
JOB NO.:	12-010
SCALE:	AS NOTED

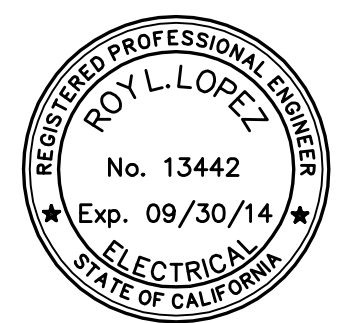

List-served-by-generators-12/07/2012 11:06
 Last plotted by gennetw@cs.cmu.edu
 Plot: K:\TEAM\12168\Gen\12168-E2.14.dwg - 12/07/2012 11:06